# JCB ENERGY ELECTRIC POWER INDUSTRY

**JUENERGY** 

\*\*\*\* \* \* \*\*\*

**WADRID / SPAIN** 





231 / 400 V - 50 Hz & 277 / 480 V - 60 Hz







## **GENERATOR GENERAL INFORMATION**

GENERATOR	FREQUENCY	VOLTAGE	POWER FACTOR	SPEED	DIESEL ENGINE		ALTERNATOR			TYPE OF	GENERAT	TOR OUTPL	іт	
Model	Hz	V	Cos Q	Rpm	Brand	Model	Series	Brand	Model	Series	Operation	kVA	kW	А
								C			Standby	1.925,0	1.540,0	2.781,8
JCN 1925	50	231/400	0.8	1500					јсв	450S	Prime	1.750,0	1.400,0	2.528,9
						JCN A2380JCI					Continuous	1.225,0	980,0	1.770,2
					JCIN						Standby	1.925,0	1.540,0	2.781,8
JCN 1925	60	277/480	0.8	1800				ິດິ	ିର୍		400L2	Prime	1.750,0	1.400,0
								$\prec$			Continuous	1.225,0	980,0	1.770,2
<ul> <li>Diesel Engines with Advanced Technology and Quality</li> <li>Alternators with Advanced Technology and Quality</li> <li>Low Exhaust Emission</li> </ul>						• Fuel • Low l	Filter wit Fuel Con	h Water a sumption	and Partic , Low Oil	ss Product Sup le Separator Consumption				
<ul> <li>Control Panel Suitable for Flexible Application</li> </ul>							<ul> <li>Global Technical Service and Maintenance Support</li> </ul>							

- Patented Compact Designed and Sound proof Canopy Wide Range of Affordable Spare Parts Low Operating Cost, Suitable for Heavy-Duty High Quality and Reliable Technology Half Century Experience in Generator Manufacturing
- Durability, Low Noise Level

#### **STAND BY POWER RATING - (ESP):**

ESP is applicable for supplying emergency power for the duration of the utility power outage. No overload capability is available for this rating. Under no condition is an engine allowed to operate in parallel with the public utility at the Stand by Power rating. This rating should be applied where reliable utility power is available. A Stand By rated engine should be sized for a maximum of an 70% average load factor and 200 hours of operation per year. This includes less than 25 hours per year at the Stand by Power rating. Stand By ratings should never be applied except in true emergency power outages. Negotiated power outages contracted with a utility company are not considered an emergency.

#### **PRIME POWER RATING - (PRP):**

Applicable for supplying electric power in lieu of commercially purchased power. Prime Power applications must be in the form of one of the following two categories:

#### **UNLIMITED TIME RUNNING PRIME POWER (ULTP):**

PRP (Prime Power) is available for an unlimited number of hours per year in a variable load application. Variable load should not exceed a 70% average of the Prime Power rating during any operating period of 250 hours. The total operating time at 100% Prime Power shall not exceed 500 hours per year. A 10% overload capability is available for a period of 1 hour within a 12-hour period of operation. Total operating time at the 10% overload power shall not exceed 25 hours per year.

#### LIMITED TIME RUNNING PRIME POWER (LTP):

LTP (Limited Time Prime Power) is available for a limited number of hours in a no variable load application. It is intended for use in situations where power outages are contracted, such as in utility power curtailment. Engines may be operated in parallel to the public utility up to 750 hours per year at power levels never to exceed the Prime Power rating. The customer should be aware, however, that the life of any engine will be reduced by this constant high load operation. Any operation

#### **CONTINUOUS POWER RATING (COP):**

COP is the power that the engine can continue to use under the prescribed speed and the specified environment condition in the normal maintenance period stipulated in the manufacturing plant. And Continuous Power is applicable for supplying utility power at a constant 100% load for an unlimited number of hours per year. No overload capability is available for this rating.





231 / 400 V – 50 Hz & 277 / 480 V – 60 Hz



## PAY ATTENTION TO THE POINTS BELOW IN PICKING AND USING THE GENERATOR

\* Generators can work on Continuous Power at 70% of Prime power value if only all maintenances are done on time with original spare parts and high-quality oils that manufacturer advice.

\* Generators should not operate below 50% of Prime Power value. In such a case, the engine will burn excessive oil and eventually have irreparable damage.

\* If your need is 1000 kVA or above, you should prefer Synchronic Systems with 2-3 generators with failure back up and simultaneous aging.

\* These points will provide advantage for you with purchasing and operating the generator.


#### **GENERATOR DIMENSIONS AND TECHNICAL DRAWINGS**





VALUES		OPEN TYPE GENERATOR	CANOPY TYPE GENERATOR
WIDTH	mm	2465	2418
LENGTH	mm	4500	7885
HEIGHT	mm	2463	3308
WEIGHT (NET)	Kg	8270	18350
FUEL TANK CAPACITY	L	3000	3000

SYMBOL	OPEN	CANOPY
L	4500	7885
W	2465	2418
н	2463	2508
S		800
Α	400	
В	1940	
С	2050	
D1		1044
D2		1044
D3		1044
D4		1044
D5		1044



## **FUEL CONSUMPTION**

PERCENT OF PRIME POWER	1500 rpm	1800 rpm
	l/hr	l/hr
110 %	377,58	377,58
100 %	340,27	340,27
75 %	256,50	256,50
50 %	172,74	172,74



231 / 400 V – 50 Hz & 277 / 480 V – 60 Hz



## **DIESEL ENGINE MAIN TECHNICAL PARAMETERS**

GENERAL		
Number of Cylinders		12
Configuration		V-Type
Aspiration		Turbocharged & Intercooled
Combustion System		Direct Injection
Compression Ratio		14:1
Bore	~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~	152
	mm	
Stroke	mm	165
Displacement	L	35,9
Governing Type		Electronic
Governing Class		G3
Rotation		Counterclockwise
Firing Order		1-12-5-8-3-10-6-7-2-11-4-9
Emission		Tier II
Moments of Rotation Inertia		
Engine	Kg - m²	24,19
Flywheel	Kg - m²	15,38
Performance Rating		
Speed Droop	%	≤1
Steady State Speed Band	%	≤0,5
FILTERS		
Air Filter		Dry Type, Replaceable
Fuel Filter		With Water Separator
Oil Filter		Element Type, Particulate Trap
FLYWHEEL HOUSING AND FLEX COUPLING		
Flywheel Housing	SAE (J620)	0
Flex Coupling Disc	Inch (")	18
TEST CONDITIONS		
Ambient Temperature	%	25
Atmospheric Pressure	КРа	100
Relative Humidity	Rh (%)	30
Max. Operating Intake Resistance	KPa	<6,2
Exhaust Backpressure Limit Fuel Temperature (Fuel Inlet Pump)	KPa °C	<6 38±2
OVERALL DIMENSIONS		J0⊥Z
Length*	mm	2460
Width	mm	2371
Height	mm	2463
Dry Weight	kg	3800
*From front end of radiator to near end of air filter		
FAN	mm	1900
	mm	1,04:1
Diameter Drive Ratio		
Drive Ratio		
		10 Plastic



231 / 400 V – 50 Hz & 277 / 480 V – 60 Hz



## **DIESEL ENGINE MAIN TECHNICAL PARAMETERS**

COOLING SYSTEM			
Radiator Type	50ºC	Tropical	
Total Coolant Capacity	L	250	
Max. Perm. Coolant Outlet Temperature	ōC	105	
Max. Perm. Flow Resist. (Cool. System And Piping)	bar	0,5	
Max. Temperature of Coolant Warning	₅C	95	
Max. Temperature of Coolant Shutdown	₅C	98	
Thermostat Operation Temperature - Initial Open	°C	66	
Thermostat Operation Temperature - Full Open	°C	78	
Delivery of Coolant Pump	m ³/ h	14,50	
Min. Pressure Before Coolant Pump	bar	0,5	
Radiator Face Area	m²	3,98	
Rows	Row	7	
Matrix Density	Per / Inch	18	
Material		Aluminum	
Width of Matrix	mm	1940	
Height of Matrix	mm	2050	
Pressure Cap Setting	kPa	90	
Estimated Cooling Air Flow Reserve	kPa	0,125	
Engine Pre Heater-Tube (with Circulation Pump)	W	6600	
LUBRICATION SYSTEM			
Total System	L	90	
Minimum Oil Level	L	85	
Nominal Motor Operating Temperature	°C	40	
Lubricating Oil Pressure (Rated Speed)	bar	7	
Relief Valve Opens	kPa	200	
Oil / Fuel Consumption Ratio	%	≤0,48	
Normal Oil Temperature	₅C	110	
ELECTRICAL SYSTEM			
Voltage	V	24	
Starter	kW	13	
Alternator Output Ampers	А	60	
Alternator Output Voltage	V	28	
Batteries Capacity	Ah	2X200	



231 / 400 V – 50 Hz & 277 / 480 V – 60 Hz



## **JCB ENERGY DIESEL ENGINE POWER RATINGS**

ENGINE MODEL	A2380JCI		ENGINE FAMILY	JC66	ENGINE SERIES	All	
					3		
Speed (Rpm)	Type of Operation	TYPICAL GENERATOR OUTPUT (NET)		Gr	OSS	Net	
		kVA	kWe	KWm	Нр	kWm	Нр
1500	Stand By(Maximum)	1.926,0	1.541,0	1.640,0	2.201,3	1.605,0	2.154,4
	Prime	1.750,0	1.400,0	1.493,0	2.004,0	1.458,0	1.957,0
1800	Stand By(Maximum)	1.926,0	1.541,0	1.640,0	2.201,3	1.605,0	2.154,4
	Prime	1.750,0	1.400,0	1.493,0	2.004,0	1.458,0	1.957,0

## **DIESEL ENGINE MATCHING PARAMETERS - 50 HZ**

50 HZ @ 1500 R/MIN		STAND BY	PRIME
Gross Engine Power	kW	1640,0	1493,0
Net Engine Power	kW	1605,0	1458,0
Fan Power Consumption (Belt Pulley Driven)	kW	32,0	32,0
Other Power Loss	kW	3,0	3,0
Mean Effective Pressure	MPa	3,66	3.04
Intake Air Flow	m <sup>3</sup> / min	135,28	128,17
Exhaust Temperature Limit	₅C	650	650
Exhaust Flow	m ³/ min	356,00	339,17
Boost Pressure Ratio		3,40	3,50
Mean Piston Speed	m / s	8,3	8,3
Cooling Fan Air Flow	m ³/ min	2058,0	2058,0
Typical Generator Output Power	kVA	1926	1750
HEAT REJECTION		STAND BY	PRIME
Energy in Fuel (Heat of Combustion)	kW	4100,0	3733,0
Gross Heat to Power	kW	1640,0	1493,0
Energy to Coolant and Lubricating Oil	kW	697,0	635,0
Heat Dissipation Capacity *	kW	287,0	261,0
Energy to Exhaust	kW	1189,0	1082,0
Heat to Radiation	kW	123,0	112,0
*Intelia Internetal el enetere			

\*Intake Intercooled system



231 / 400 V – 50 Hz & 277 / 480 V – 60 Hz



## **DIESEL ENGINE MATCHING PARAMETERS - 60 HZ**

60 HZ @ 1800 R/MIN		STAND BY	PRIME
Gross Engine Power	kW	1640,0	1493,0
Net Engine Power	kW	1605,0	1458,0
Fan Power Consumption (Belt Pulley Driven)	kW	32,0	32,0
Other Power Loss	kW	3,0	3,0
Mean Effective Pressure	MPa	3,66	3.04
Intake Air Flow	m ³ / min	135,28	128,17
Exhaust Temperature Limit	°C	650	650
Exhaust Flow	m ³ / min	356,00	339,17
Boost Pressure Ratio		3,40	3,50
Mean Piston Speed	m / s	8,3	8,3
Cooling Fan Air Flow	m ³ / min	2058,0	2058,0
Typical Generator Output Power	kVA	1926	1750
HEAT REJECTION		STAND BY	PRIME
Energy in Fuel (Heat of Combustion)	kW	4100,0	3733,0
Gross Heat to Power	kW	1640,0	1493,0
Energy to Coolant and Lubricating Oil	kW	697,0	635,0
Heat Dissipation Capacity *	kW	287,0	261,0
Energy to Exhaust	kW	1189,0	1082,0
Heat to Radiation	kW	123,0	112,0
*Intake Intercooled system			

#### JCB ALTERNATOR TECHNICAL PARAMETERS AND SPECIFICATIONS



ALTERNATOR TECHNI	CAL PARAMETERS				
Insulation Class		Н	Field Control System		Self-Excited
Winding Pitch		2/3 - (N° 6)	A.V.R. Model	Standard	MX321+PMG
Wires		6	Voltage Regulation	%	± 1
Protection		IP 23	Sustained Short-Circuit Current	10 sec	300% (3 IN)
Altitude	m	1000	Total Harmonic (*) TGH / THC	%	< 4
Overspeed	rpm	2250	Wave Form: NEMA = TIF - (*)		< 50
Air Flow	m³/sec.	2,69	Wave Form: I.E.C. = THF - (*)	%	< 1.5
Bearing Drive	N/A	-	Bearing Non-Drive	Bearing	6319-2RZ
Rotor Winding	100%	Copper	Stator Winding	100%	Copper



231 / 400 V – 50 Hz & 277 / 480 V – 60 Hz



## **ALTERNATOR SPECIFICATIONS**

#### 50 HZ / 231-400V COSQ 0,8 / 1500 RPM

STANDARD USING ALTERNATOR				OPTIONAL USING ALTERNATOR					
BRAND/MODEL		JCB 450S		LEROY-SO	OMER	LSA 52.3S5	STAMFORD	P7E	
DUTY				Continuous				Stand By	
AMBIENT	C°			40°C				27°C	
CLASS / TEMP. RISE	C°			H/ 125° K				H/ 163° K	
SERIES STAR	V	380/220	400/231	415/240	1 Phase	380/220	400/231	415/240	1 Phase
PARALLEL STAR	V	190/110	200/115	208/120	220	190/110	200/115	208/120	220
SERIES DELTA	V	220	230	240	230	220	230	240	230
OUTPUT POWER	kVA	1750,0	1750,0	1785,0	-	1925,0	1925,0	1964,0	-
OUTPUT POWER	kW	1400,0	1400,0	1428,0	-	1540,0	1540,0	1571,2	-

#### 60 HZ / 277-480V COSQ 0,8 / 1800 RPM

STANDARD USING ALTERNATOR				OPTIONAL USING ALTERNATOR					
BRAND/MODEL	JUENERGY	JCB 400L2		LEROY-	SOMER	LSA 50.2L8	STAMFORD	\$7L1	D-C4
DUTY				Continuous			Sta	nd By	
AMBIENT	C°			40°C			2	7°C	
CLASS / TEMP. RISE	C°			H / 125° K			н/	163° K	
SERIES STAR	V	416/240	440/254	480/277	1 Phase	416/240	440/254 <b>4</b>	80/277	1 Phase
PARALLEL STAR	V	208/120	220/127	240/138	-	208/120	220/127 <b>2</b>	40/138	-
SERIES DELTA	V	240	254	277	240	240	254	277	240
OUTPUT POWER	kVA	1750,0	1750,0	1785,0	-	1925,0	1925,0	1964,0	-
OUTPUT POWER	kW	1400,0	1400,0	1428,0	-	1540,0	1540,0	1571,2	-



231 / 400 V – 50 Hz & 277 / 480 V – 60 Hz



## **CONTROL MODULE ALERTS**

Emergency Stop Malfunction High Generator Frequency Low Generator frequency, Low Load Over Current, Unbalanced Current Low Generator Voltage High generator Frequency Phase sequence error Overload, Heat Sensor Broken Low Water Level (Optional) Low Oil Pressure, Reverse Power Low Water Temperature

Start Error, Stop Error Magnetic Pickup Error Charge Alternator Error Unbalanced Load Maintenance Time Alarm Low Speed, High Speed Broken Oil Sensor Cable High Oil Temperature (Optional) Low Fuel Level (Optional), High Battery Voltage Low Battery Voltage, High Water Temperature Electronic Can bus Errors (ECU)

#### **CONTROL PANEL SPECIFICATIONS**



- Powder Painted Steel Panel with Lockable Door
  - Optional
- Control Module
- Battery Charger
- Emergency Stop Button

- Terminal Blocks
- Load Output Terminal
- System Protection MSBs
- Circuit Breaker-Optional
- o LCD Screen
- Control Relays
- Backlit, 128x64 Pixels

#### **CONTROL MODULE TECHNICAL PARAMETERS**

Brand	<b>JUENERGY</b>	Brand	Trans-MIDIAMF.232.GP	
Dimensions	120mmx94mm.	Protection Class IP65 From the Front		
Weight	260 gr.	<b>Environmental Conditions</b>	2000 meters above sea level	
Ambient Humidity	Max. %90.	Ambient Temperature-20°C to +70°C		
DC Battery Supply Voltage	8 - 32 V	Battery Voltage Measurement 8 – 32 V		
Network Frequency	5 - 99,9 Hz	Mains Voltage Measurement	3 - 300 V phase -Neutral, 5 - 99,9 Hz	
Generator Voltage Measurement	3 - 300 V	Generator Frequency	uency 5 - 99,9 Hz	
Current Transformer Secondary	5A	Working Period	Continuous	
Charge Alternator Voltage Measurement	8 - 32 V	Charge Alternator Excitation	210mA &12V, 105mA &24V Nominal 2.5W	
Communication Interface	RS-232	Analog Sender Measurement	0 - 1300ohm	
Generator Contactor Relay Output	5A & 250V	Mains Contactor Relay Output	5A & 250V	
Solenoid Transistor Outputs	1A with DC Supply	Start Transistor Outputs	1A with DC Supply	
Configurable-3 Transistor Outputs	1A with DC Supply	Configurable-4 Transistor Outputs	uts 1A with DC Supply	



231 / 400 V – 50 Hz & 277 / 480 V – 60 Hz



## **CONTROL MODULE FUNCTION**

Mains Voltage Level Control	Generator Voltage Level Control	3 Phase Generator Protections	3 Phase AMF Function	Alarm Horn
Network Frequency Level Control	Generator Frequency level Control	- High / Low Voltage	- High / Low Frequency	Heater Tube Thermostat Control
Engine Operating Option Control	Generator Current Level Control	- High / Low Frequency	- High / Low Voltage	Modbus and SNMP
Engine Stop Option Control	Generator Powder Level Control	<ul> <li>Current / Voltage</li> <li>Asymmetry</li> </ul>	- High / Low Water Temperature	Working Hour
Engine Speed (RPM) Level Control	Generator work Schedule and Timing Control	- Overcurrent / Overload	- High / Low Load	Ground Leakage
Battery Voltage Options Times	Oil Pressure Controllers Control	Overheat Control	Mains., Generator ATS Control	Analog Modem
Check Engine Maintenance Times	Configurable Analog Inputs and Outputs	1 Phase or 3 Phase, Phase Selection	Network, Voltage, Frequency Display	Ethernet, USB, RS232, RS485
Communication Interfaces GPRS, GSM	Keeping Error Records of Past Events	Parameter Setting via Control Module	Parameter Setting via Computer	Selectable Protection Alarm / Shutdown
Engine Speed, Voltage, Earning	Configurable Programmable Digital Inputs and Outputs	Water Temperature Current and Frequency	Hours of Operation Phase sequence	Battery Voltage Oil Pressure

#### SOUND PROOF CANOPY AND BASE FRAME (CHASIS) SPECIFICATIONS





- Special, Registered JCB Energy Design and Colour
- A1 Quality DKP / HRU / Galvanized Steel
- Sensitive Twist on Automatic Press Brake
- Delicate Cut on Automatic Punch and Laser Bench
- Sensitive Welding on Robotic Welding Bench
- Chemical Cleaning Nano Technology Before Painting
- Robotic Painting with Electrostatic Powder Paint
- Drying and stabilizing on 200 °C Ovens
- 1500 Hour Salt Test
- o Glass wool Isolation, A1 Class Material -50/+500 ℃
- Special Covering Over Glass Wool
- Best Sound Level (in Dba)
- Temperature Tests
- Rustproof Accessories


- Cable Exit Connectors and Glands
- Emergency Stop Button
- Fuel Level Gauge
- Fuel Drain Cap
- Fuel Inlet and Return Records
- Impermeability Test for Fuel Tank
- Vacuumed Rubber Mounted
- High Quality weatherstrips
- High Quality Shock Absorbers
- Fuel Filling Cap (with ventilation)
- Lifting and Carrying Equipment
- Internal Exhaust Mufflers (Silencers)
- External Exhaust Mufflers (Silencers)
- Radiator water Filling Cap
- o Daily Fuel Tank, External Fuel Tank

# SERTİFİKATLARIMIZ



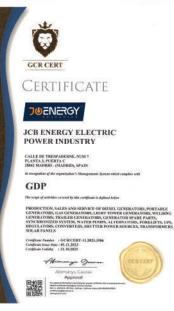

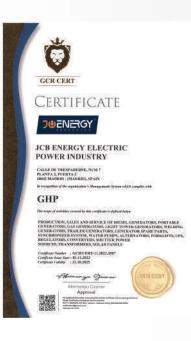

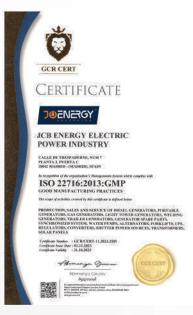



CERTIFICATE HEALTHY & SAFE WORKPLACE CERTIFICATE

#### JOENERGY

JCB ENERGY ELECTRIC POWER INDUSTRY

CALLE DE TRESPADERNE, NUM 7 PLANTA 2, PERTA C 2004 DANORD - OKOLIDID, JERAEN Elisa been entrete to obtain a Munity and Safe Workplans Centrace by fulfiling the segmentement for DDM DI sessions, where the phaseal confliction of the location who in the second of the Mathy and Safe Workplans Centralizes improve the in the second of the Mathy and Safe Workplans Centralizes improve.


FACTORIES - PRODUCTION LOCATIONS: ELECTRICAL AND ELECTRONICS INDUSTRY

Compliant Number : GCR/CERT-11.2023.3650 Compliant June Ball: 107.11.2023 Compliant June Ball: : 06.11.2023








CE -VERTA-106188 -VERTA-106189

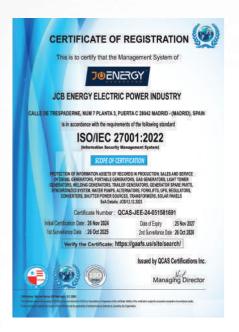



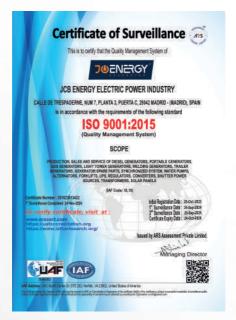

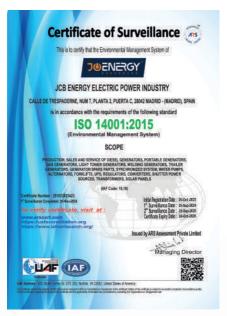

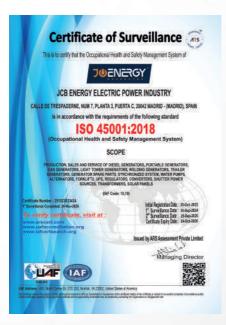

CE -VERTA-106188 -VERTA-106189

#### DNV

#### MANAGEMENT SYSTEM CERTIFICATE

#### Certificate no: Initial certification date: D012084 14 August 2007

The is to cardy that the management system of HD Hyundai Infracore Co., Ltd. Head Office & Incheon Plant 40 (highes). Drops, indexe, 2200, Republic of Korea and the sites as mentioned in the appendix accompanying this cartificate has been toyaid to conform to the Environmental Management System standard. Iso 14001;2015

Valid: 14 October 2023 - 13 October 2026

The certificate is walls for the following scope: Design, Development, Manufacture, Servicing of Internal Combustion Engine for use in Marine Industry, General Industry and Automotive Industry, and Earth Moving Equipment[Excavator, Wheel Loader, Dezer], Testing of Earth Moving Equipment[Excavator and Wheel Loader].





#### DNV

<section-header><section-header><text><text><text><text><text><text><text><text>





Lanuari de meterre metorerres de Madera SALIDA IF de Registra 1415/80.645 Focies 2597.2223 12/82.09

RENE SANCHEZ ROMAN, MANAGER CH'THE DERIMETATION OF LIGAL ADVISORY SERVICES AND THE DATAMASE OF THE OFFICIAL OMAXBER OF COMMERCE, MOLERIF AND SERVICES OF MARIND, WITH INDUSTRIED OFFICE AT PLAZA DE LA INDERDIDICA 1, MARIND, DAVIN

CERTIFY. That, according to the background data on moord at this Chambar and others produced by the Company

CB-BERGY RECEISE FOMBLINGOTINE SL, a Company with Tax ID. Namine H1997554, and to registress office a strengt impactements in 2000 Masking is registred on MMp 2004, and the heading of the 3D Service comparise, of the Economic Activities Tax Tarihi function 540 spectrum the future gradient of the Service comparison.

· Menufacture of electrical material for use and equipment

In whites whereast, for the appropriate purpose, i have issued and signed this Certificate, to which Latts the stamp of this Chamilee, in Madrial on 28 July 2004.





Libratus de Manare Maista Maria Nº de Register 155 / 85 660 Fecha: 3607/355 1357/35

BENE SANCHEZ ROMAN, DIRECTORA DEL DEIWOTMENTO DE ASESORIA IMPORTA Y CINSO DE LA CIMARIA OFICIAL DE COMERCIO, INDUSTINA Y SURVICIS DE MARIRO, CON OCIACIONI SOCIAL EN LA TILAZA DE LA INDEPENDENCIA Y IL IMPORTO-ENTRATA CERTIFICA Que de los antecedentes que obrin en ente Cuipenación y de coso entididos por la recordad, manta

HIMPING due la compañía ACI INTROV ELECTIC ENVERT ADALTINE 4.1. a con accéption preventi de proclamation equation, constituit de moltante existence hanne acception preventi de la constituit de moltante existence hanne Calegoria de Marcía de activitativa en la constituit de moltante hanne acception de la constituit de la constituit de moltante la constituit de activitati à la constituit de la constituit de la constituit de activitati à la constituit de la constituit de la constituit de activitati à la constituit de la constituit de la constituit de activitati à la constituit de la constituit de la constituit de activitati à la constituit de la constituit de activitati à la constituit de la constituit de activitati de la constituit de activitati de la constituit de activitati de la constituit de activitati de la constituit de activitati de la constituit de activitati de la constituit de activitati de la constituit de activitati de la constituit de activitati de la constituit de activitati de

"Actividad propipal 27,11 Astronautiv de matures, gebreradores y transformadar eléctricos".

METRODA: METRODA: Can explore and expensive due la socitura die contribución el capital encid de la compartía (x.p. 1948/07 18/2758). ENARE INDUSTRY SLL se fije en la centided de 1940/014 el (Electorization el capital de la contracta d

Operational processing to consider the electron of economic determined and the electron of the

Conjug productions of the compariso ACI MINITORY FLICTING: CONVEX INFOLISTINY SL, con domicilia an calle Traspademe namera 7, 20042. Majorida y provide de Namera de Namificación radia 19:207528, contras dada de esta en el gruportapidante da la Sacolín II amprovancia de las Tanfas del Inguestos sobre Actividades Económicas, qui finalda para ejecto ha estardad. Términaria de manerala difectivo de Milantetory reglamentari.









R

www.jcbenergy.com



9

T